




OVERHEAD SERVICE TO
BUILDING - GABLE END

2024 EDITION

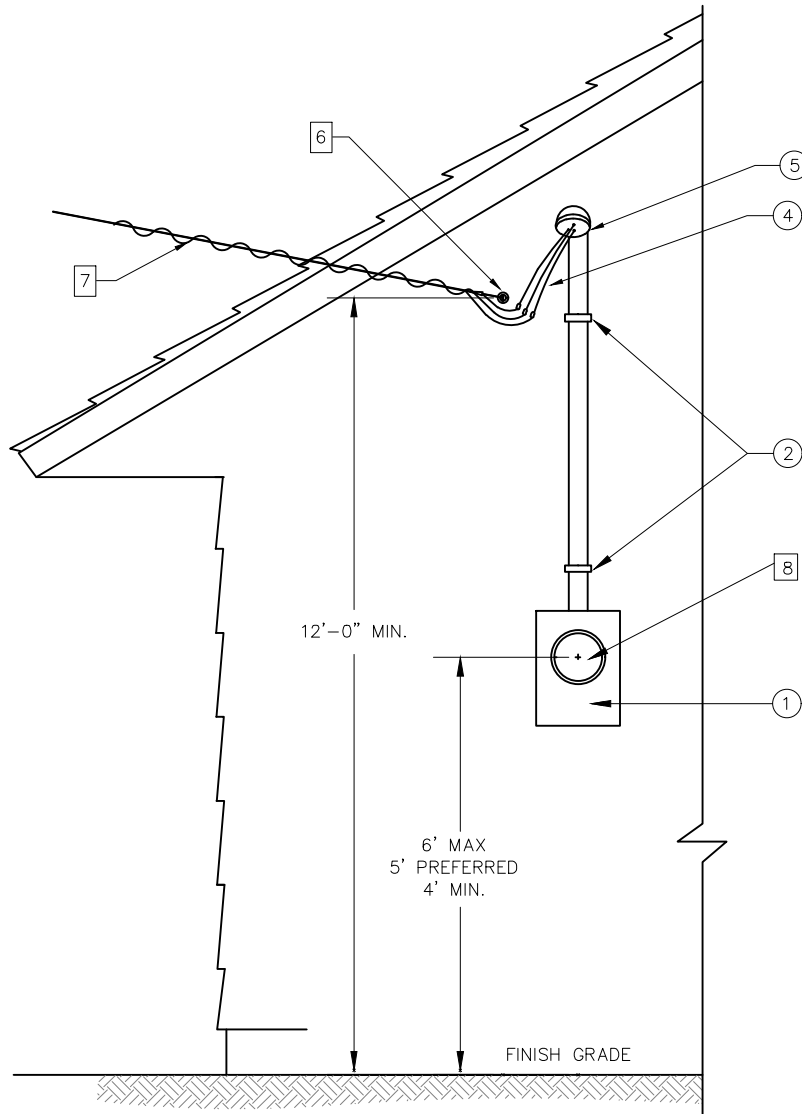

NOTES

1. ALL METERING INSTALLATIONS SHALL BE BONDED AND GROUNDED PER CURRENT N.E.C. AND LOCAL JURISDICTION AGENCY REQUIREMENTS.
2. SERVICE MAST MUST BE TALL ENOUGH TO PROVIDE REQUIRED CLEARANCES FROM GROUND TO SERVICE CONDUCTORS EVERYWHERE IN THE SPAN (REFER TO SPEC "VERTICAL CLEARANCES").

ITEMS OWNED AND INSTALLED BY THE MEMBER:

1. METER SOCKET AND DISTRIBUTION PANEL (200-400AMP, 120/240 VOLT)
2. CONDUIT STRAPS SOLIDLY SECURED TO BUILDING STRUCTURAL SUPPORTS
3. GROUND RODS & WIRE IN ACCORDANCE WITH NEC (NOT SHOWN)
4. SERVICE ENTRANCE CONDUCTORS - 24" OUT OF WEATHERHEAD
5. CONDUIT RISER AND WEATHERHEAD

ITEMS OWNED AND INSTALLED BY THE UTILITY:

6. INSULATED CLEVIS
7. SERVICE LINE
8. METER