





# COMMERCIAL PAD MOUNT TRANSFORMER SITE INFORMATION

## CLEARANCE DETAIL

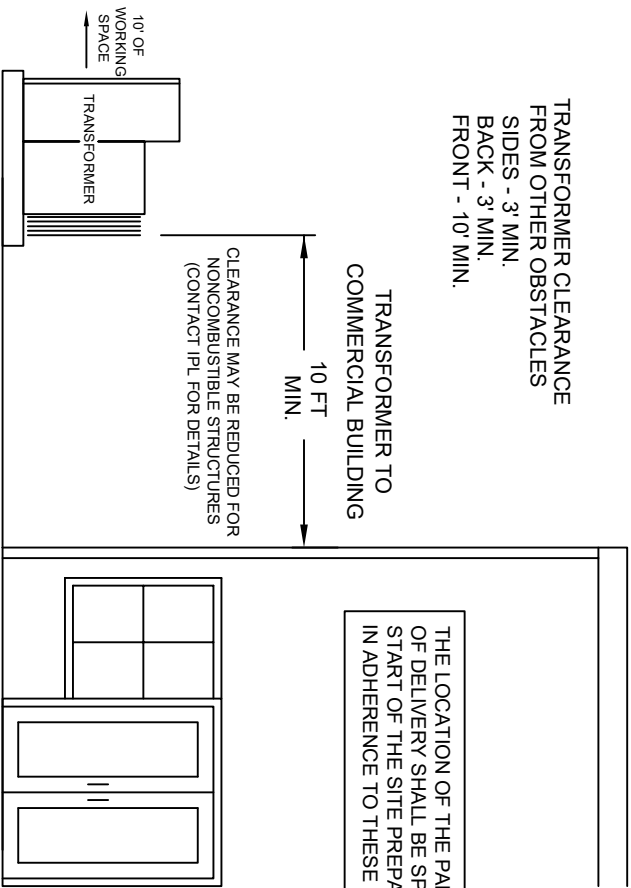

## BARRIER WALL DETAIL

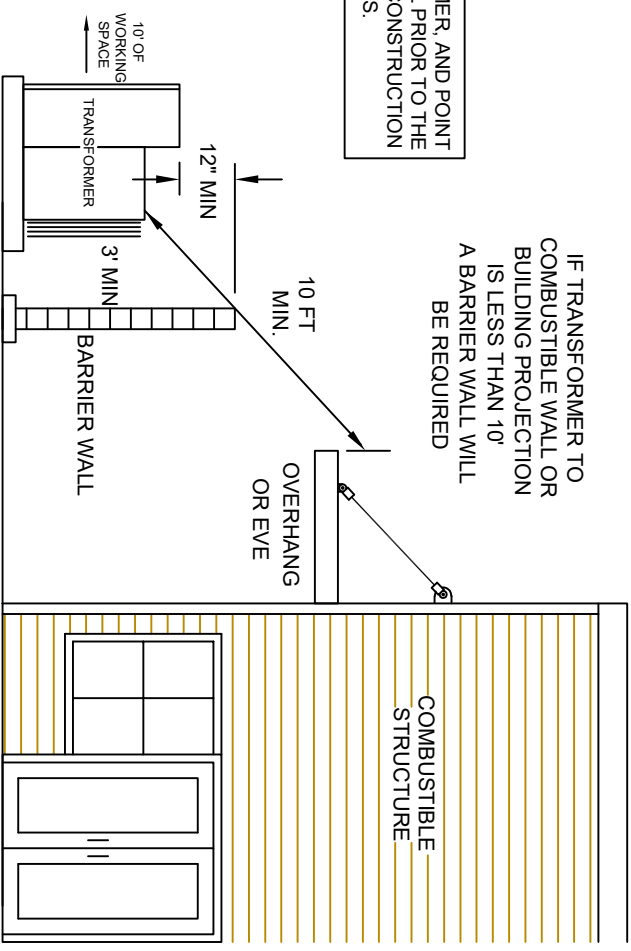

DISTANCE IS MEASURED FROM THE BACK OF THE TRANSFORMER TO THE BUILDING WALL OR THE OUTER EDGE OF ANY OVER HANGS.

FIRE ESCAPES, OUTSIDE STAIRS, AND COVERED WALK-WAYS ATTACHED TO OR BETWEEN BUILDINGS SHALL BE CONSIDERED AS PART OF THE BUILDING.

IF CLEARANCES SHOWN CANNOT BE MET, SEE "BARRIER WALL" DETAIL.

THE BARRIER WALL MUST BE CONSTRUCTED OF A NON-COMBUSTIBLE MATERIAL. SUCH AS REINFORCED CONCRETE, SOLID CONCRETE BLOCK, OR STEEL

REFER TO NESC 15 152 A2 OR NEC 450-27.

