




OVERHEAD VERTICAL CLEARANCES TO CONDUCTORS

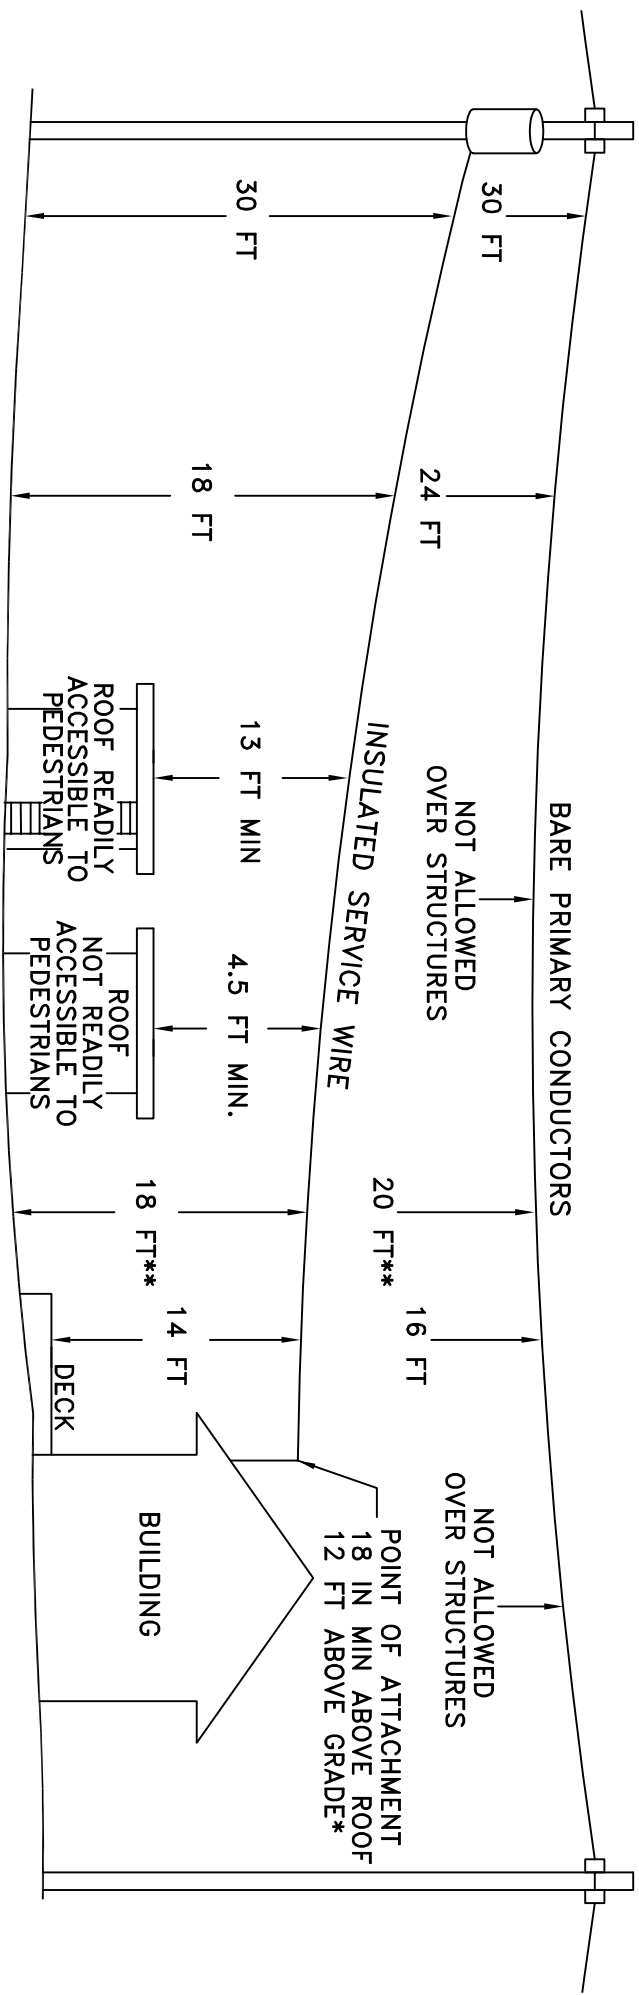

\* (MINIMUM) INCREASE AS NEEDED TO MAINTAIN PROPER CLEARANCES OVER OTHER SURFACES (CONSULT INLAND POWER & LIGHT)

SWIMMING POOLS AND HOT TUBS  
NEITHER PRIMARY OR SECONDARY WIRES ALLOWED TO CROSS OVER

RESIDENTIAL PROPERTY / DRIVEWAY  
CULTIVATED FIELDS  
GRAZING AREAS, FOREST  
ORCHARDS SUBJECT  
TO VEHICLE TRAFFIC

\*\*INCREASE TO 30' IN AREAS SUBJECT TO FARM EQUIPMENT

STATE HWYS  
STREETS, ALLEYS,  
COUNTY ROADS  
LAND ACCESSED BY  
VEHICLE OR EQUESTRIAN

ROOF READILY ACCESSIBLE TO PEDESTRIANS  
ROOF NOT READILY ACCESSIBLE TO PEDESTRIANS

BUILDING

NOTE:  
CONTACT IPL FOR CLEARANCE REQUIREMENTS TO GRAIN BINS, BILLBOARDS, SIGNS, ANTENNAS, FLAG POLES OR OTHER EQUIPMENT  
FOR PROPANE TANKS, PLEASE REFER TO THE NFPA CODE REQUIREMENTS FOR CLEARANCE INFORMATION.