




OVERHEAD VERTICAL CLEARANCES TO CONDUCTORS

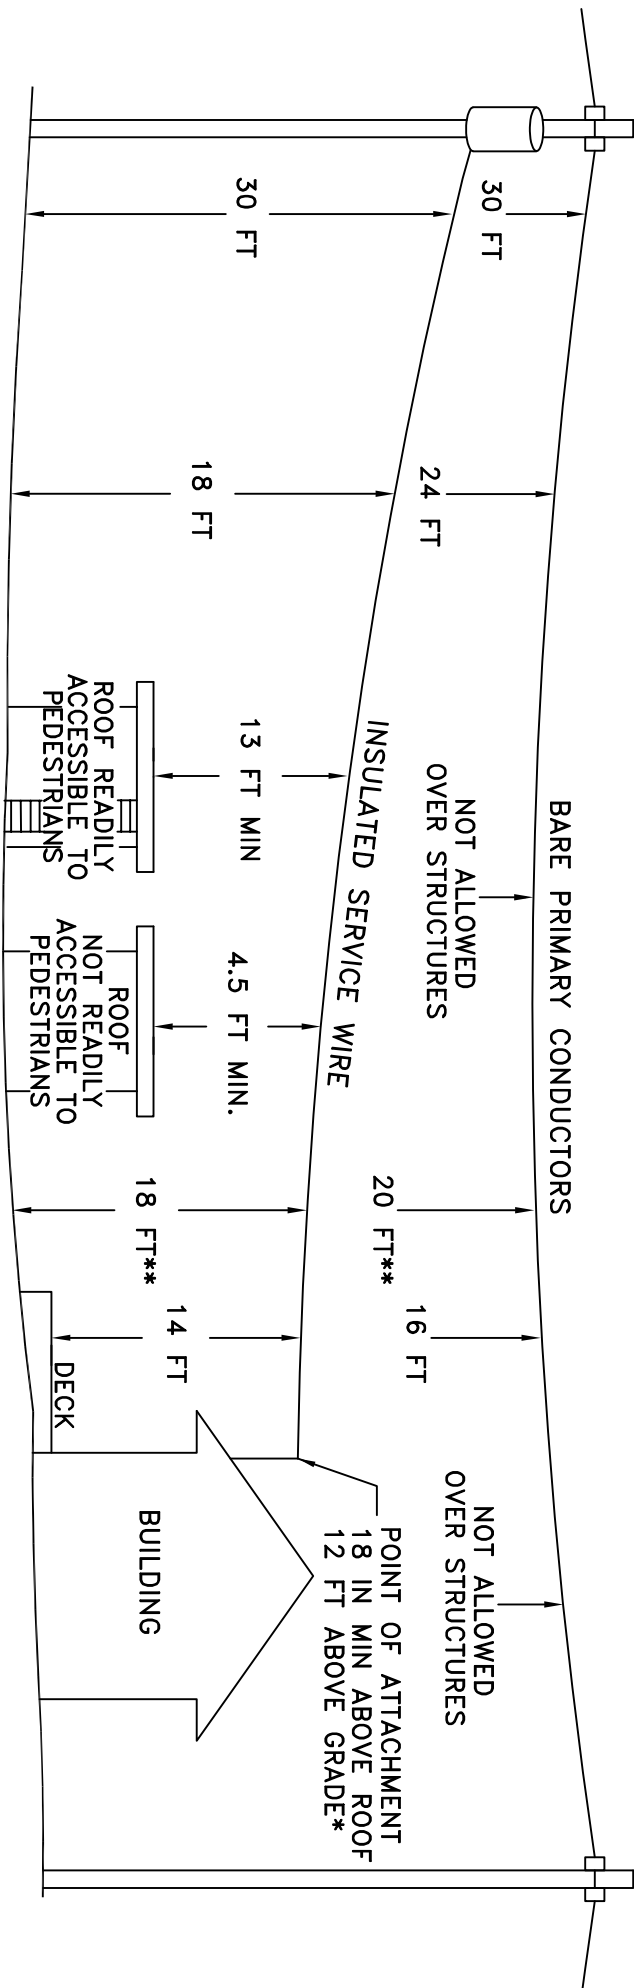

* (MINIMUM) INCREASE AS NEEDED TO MAINTAIN PROPER CLEARANCES OVER OTHER SURFACES (CONSULT INLAND POWER & LIGHT)

SWIMMING POOLS AND HOT TUBS
NEITHER PRIMARY OR SECONDARY WIRES ALLOWED TO CROSS OVER

**INCREASE TO 30' IN AREAS SUBJECT TO FARM EQUIPMENT

CULTIVATED FIELDS
GRAZING AREAS, FOREST
ORCHARDS SUBJECT
TO VEHICLE TRAFFIC

STATE HWYS
STREETS, ALLEYS,
COUNTY ROADS
LAND ACCESSED BY
VEHICLE OR EQUESTRIAN

ROOF READILY
ACCESSIBLE TO
PEDESTRIANS

ROOF
NOT READILY
ACCESSIBLE TO
PEDESTRIANS

RESIDENTIAL
PROPERTY/
DRIVEWAY

DECK

BUILDING

POINT OF ATTACHMENT
18 IN MIN ABOVE ROOF
12 FT ABOVE GRADE**

NOT ALLOWED
OVER STRUCTURES

NOT ALLOWED
OVER STRUCTURES

BARE PRIMARY CONDUCTORS

INSULATED SERVICE WIRE

NOTE:
CONTACT IPL FOR CLEARANCE
REQUIREMENTS TO GRAIN BINS,
BILLBOARDS, SIGNS, ANTENNAS,
FLAG POLES OR OTHER EQUIPMENT
FOR PROPANE TANKS, PLEASE
REFER TO THE NFPA CODE
REQUIREMENTS FOR CLEARANCE
INFORMATION.